


AHILYANAGAR MUNICIPAL CORPORATION, AHILYANAGAR

Telephone No. (Office) 0241-2343622, 2345123, 2340422
Fire Department :- 0241-2323370, 2320100, Fax No. 0241-2328C37
Website: www.amc.gov.in | E-mail: amc_anr@rediffmail.com



Ashad / Outward No. 184

Date: 29 / 05 / 2026

To,
Mauli Shikshan Sanstha,
Supa, Gut No. 41,
Tal. Parner, Dist. Ahilyanagar.



Subject :- Regarding Final Fire No Objection Certificate (NOC)

Reference :- 1) Provisional No Objection Certificate Ashad Outward No. 690 dated 27/02/2024
2) Your application and Token No. 130 dated 02/12/2023
3) Application dated 27/05/2026 regarding obtaining Final No Objection Certificate
4) "Class A" Certificate of FFSS / 26-27 / FA-436 dated 29/05/2026 from Fire Fight Safety Solutions


Sir,

With reference to the above subject, certificate is hereby issued that, the plot area of Mauli Shikshan Sanstha located at Gut No. 41, Supa, Tal. Parner, Dist. Ahilyanagar is 6000.00 sq.m. and the constructed area is 2117.76 sq.m., where the construction of the educational building has been completed. As per the documents submitted by you, the "Class A" certificate dated 29/05/2026 from Fire Fight Safety Solutions (FFSS / 26-27 / FA-436), and based on the site inspection conducted on 28/05/2026, the following measures have been implemented for the said building from the standpoint of fire safety in accordance with the Maharashtra Fire Prevention and Life Safety Measures Act, 2006 and Part 4 of the National Building Code 2016:

- 1) In the said building, one fire extinguisher equipment has been installed for every 100 sq.m. area as per IS: 2190:1992.
- 2) In the said building, hose reel hose has been installed near the staircase of every floor as per IS:884:1985 and 3384:1989.
- 3) A sprinkler system has been installed throughout the entire building.
- 4) A hand-operated electronic fire alarm system has been installed as per IS 2181-2008.
- 5) Underground water tank of 25,000 liters capacity and terrace tank of 20,000 liters capacity have been provided for fire fighting, along with 1 unit of 900 LPM electric pump installed on it.
- 6) Fire service inlet 2-way with landing valve has been installed in the said building.

Regarding the aforesaid measures, periodic inspection as per Section (1)/3 of the Maharashtra Fire Prevention and Life Safety Measures Act, 2006 is mandatory. Under Section (3) of the said Act, inspection must be conducted twice a year in the months of January and July through a Licensed Agency, and the inspection report along with Form "B" certificate must be submitted to the Chief Fire Officer, Central Office Fire Department Maliwada, Ahmednagar.

Under the Maharashtra Fire Prevention and Life Safety Measures Act, 2006, this "Fire No Objection Certificate" is being issued. It is mandatory to renew this No Objection Certificate before date 29/05/2027.

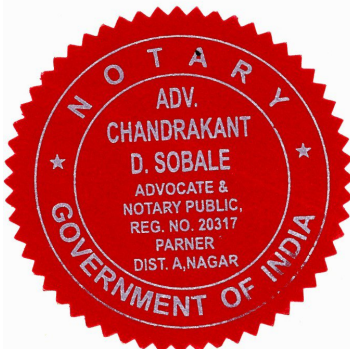

BEFORE ME

CHANDRAKANT D. SOBALE
ADVOCATE & NOTARY PUBLIC
GOVT. OF INDIA
PARNER, DIST. AHMEDNAGAR
M. 9890860087 / 9422757005

(Shankar Uttam Misal)
Chief Fire Officer
Ahilyanagar Municipal Corporation

Sr. No./C.D.S. 1/28/26
5/8/26



अहिल्यानगर महानगरपालिका, अहिल्यानगर

दुरध्वनी क्र.(कार्यालय) ०२४१- २३४३६२२, २३४५१२७, २३४०५२२
अग्निशमन विभाग :- ०२४१- २३२३३७०, २३२०१००, फॅक्स नं०२४१- २३२८८३७

Website : www.amc.gov.in E-mail : amc_anr@rediffmail.com



अशाद/ जा.क्र.१८४

दि. २९/०५/२०२६

प्रति,
माऊली शिक्षण संस्था
सुपा, गट.न.४१,,
ता.पारनेर, जि.अहिल्यानगर

विषय:- अंतीम अग्निशमन ना हरकत प्रमाणपत्रा बाबत

संदर्भ:-१) अशाद.जा.क्र.६९० दि.२७/०२/२०२४ रोजीचे प्रोव्हिजनल नहरकत प्रमाणपत्र

२) दि.०२/११/२०२३ चा आपला अर्ज व टोकन क्र.१३०

३) दि. २७/०५/२०२६ रोजीचा अंतीम नाहरकत प्रमाणपत्र मिळणेबाबतचा अर्ज

४) फायर फाईट सेफ्टी सोल्युशन्स यांचे FFSS/२६-२७/FA-४३६ दि. २९/०५/२०२६ रोजीचे "अ" प्रमाणपत्र

महोदय,

उपरोक्त विषयानुसार कळविण्यात दाखला देण्यात येतो की, माऊली शिक्षण संस्था, गट.न.४१, सुपा ता.पारनेर, जि.अहिल्यानगर येथील प्लॉट क्षेत्रफळ ६०००.०० चौ.मी. बांधकाम क्षेत्रफळ २११७.७६ चौ.मी. इतके असून येथे शैक्षणिक इमारतीचे बांधकाम बांधकाम झालेले असून आपण सादर केलेल्या कागद पत्रानुसार व फायर फाईट सेफ्टी सोल्युशन्स यांचे FFSS/२६-२७/FA-४३६ दि. २९/०५/२०२६ रोजीचे "अ" प्रमाणपत्र तसेच दि.२८/०५/२०२६ रोजीच्या स्थळ पाहणी नुसार सदर इमारतीसाठी खालील प्रमाणे बांधकाम करिता, महाराष्ट्र अग्नि प्रतिबंधक जीवसंरक्षक उपाययोजना अधिनियम २००६ अन्वये व राष्ट्रीय इमारत बांधकाम संहिता २०१६ मधील भाग ४ अन्वये अग्नि सुरक्षिततेच्या दृष्टीकोनातून खालील प्रमाणे उपाय योजना केलेल्या आहेत.

- १) सदर इमारतीमध्ये IS:२१९०:१९९२ प्रमाणे प्रत्येक १०० चौ.मि. क्षेत्रासाठी एक अग्निशामक उपकरण बसविण्यात आलेले आहे.
- २) सदर इमारतीमध्ये IS:८८४ : १९८५ व ३३८४ : १९८९ प्रमाणे होजरील होज प्रत्येक मजल्याच्या जिन्याजवळ बसविण्यात आलेले आहे.
- ३) सदर संपूर्ण इमारतीमध्ये स्प्रिंकलर सिस्टीम बसविण्यात आलेले आहे.
- ४) सदर इमारतीमध्ये हॅन्ड ऑपरेटेड इलेक्ट्रॉनिक फायर अलार्म सिस्टम IS २१८९-२००८ अन्वये बसविण्यात आलेले आहे.
- ५) इमारतीच्या अंडर ग्राउंड २५००० लिटर क्षमतेची व ट्रेरेस टॅक २०००० लिटर क्षमतेची अग्निशमन करिता पाण्याची टाकी व त्यावर ९०० LPM इलेक्ट्रिक पंप १ नग बसविण्यात आलेला आहे.
- ६) सदर इमारतीमध्ये फायर सर्किस इनलेट टू वे विथ लॅंडींग वॉल बसविण्यात आलेले आहे.

सदर उपाययोजना बाबत महाराष्ट्र आगप्रतिबंधक व जीव संरक्षक उपाययोजना अधिनियम २००६ चे कलम (१)/३ नुसार बंधनकारक असून असे परिक्षण सदर अधिनियमातील कलम (३) ३नुसार अनुज्ञाप्ती धारक अभिकरणा (Licensed Agency)कडून करून घेवून सदर अहवाल वर्षातून दोन वेळा जाणेवारी व जुलै मध्ये तपासणी करून व "ब" प्रमाण पत्रासह तसा अहवाल मुख्य अग्निशमन अधिकारी यांच्याकडे, मध्यवर्ती कार्यालय अग्निशमन विभाग माळीवाडा, अहमदनगर या कार्यालयास सादर करावा.

महाराष्ट्र अग्नि प्रतिबंधक व जीवसंरक्षक उपाययोजना २००६ अन्वये "अग्निशमन ना हरकत प्रमाणपत्र देण्यात येते सदरील ना हरकत प्रमाणपत्र दि. २९/०५/२०२७ पूर्वी नुतनीकरण करणे बंधनकारक आहे.



(शंकर उत्तम मिसाळ)
मुख्य अग्निशमन अधिकारी
अहिल्यानगर महानगरपालिका